

ATTACHMENT 2

Figures

(34 pages, including this cover page)

| Supplement ID | Description   |
|---------------|---|
| 2-1           | Indoor unit - exterior 4                            |
| 2-2           | Indoor unit - exterior 5                            |
| 2-3           | Indoor unit - exterior 6                            |
| 2-4           | Indoor unit - field wiring compartment              |
| 2-5           | Indoor unit - field wiring terminals and markings   |
| 2-6           | Indoor unit - heater kit and electrical compartment |
| 2-7           | Indoor unit - motor compartment                     |
| 2-8           | Indoor unit - motor controller                      |
| 2-9           | Indoor unit - wiring diagram                        |
| 2-10          | Indoor unit- heater kit installation site           |
| 2-11          | Outdoor unit - capacitor                            |
| 2-12          | Outdoor unit - contactor                            |
| 2-13          | Outdoor unit - exterior 1                           |
| 2-14          | Outdoor unit - exterior 2                           |
| 2-15          | Outdoor unit - nameplate                            |
| 2-16          | Indoor Unit - exterior 1                            |
| 2-17          | Indoor Unit - exterior 2                            |
| 2-18          | Indoor unit - exterior 3                            |
| 2-A4-1        | Air Handler nameplate                               |
| 2-A4-2        | Condensing Unit nameplate                           |
| 2-A4-3        | Control compartment                                 |
| 2-A4-4        | Transformer   |
| 2-A4-5        | 3.5 ton air handler                                 |
| 2-A5-1        | Indoor unit - field wiring compartment              |
| 2-A5-2        | Indoor unit - motor compartment                     |
| 2-A5-3        | Indoor unit - wiring diagram                        |
| 2-A5-4        | Outdoor unit - exterior back                        |
| 2-A5-5        | Outdoor unit - exterior front                       |
| 2-A5-6        | Outdoor unit - field wiring compartment             |

|        |   |
|--------|---|
| 2-A5-7 | Indoor unit - exterior on wiring compartment side |
| 2-A5-8 | Indoor unit - exterior test duct                  |
| 2-A5-9 | Indoor unit - Field wiring compartment cover      |


Figures ID 2-1

Indoor unit - exterior 4



Figures ID 2-2

Indoor unit - exterior 5

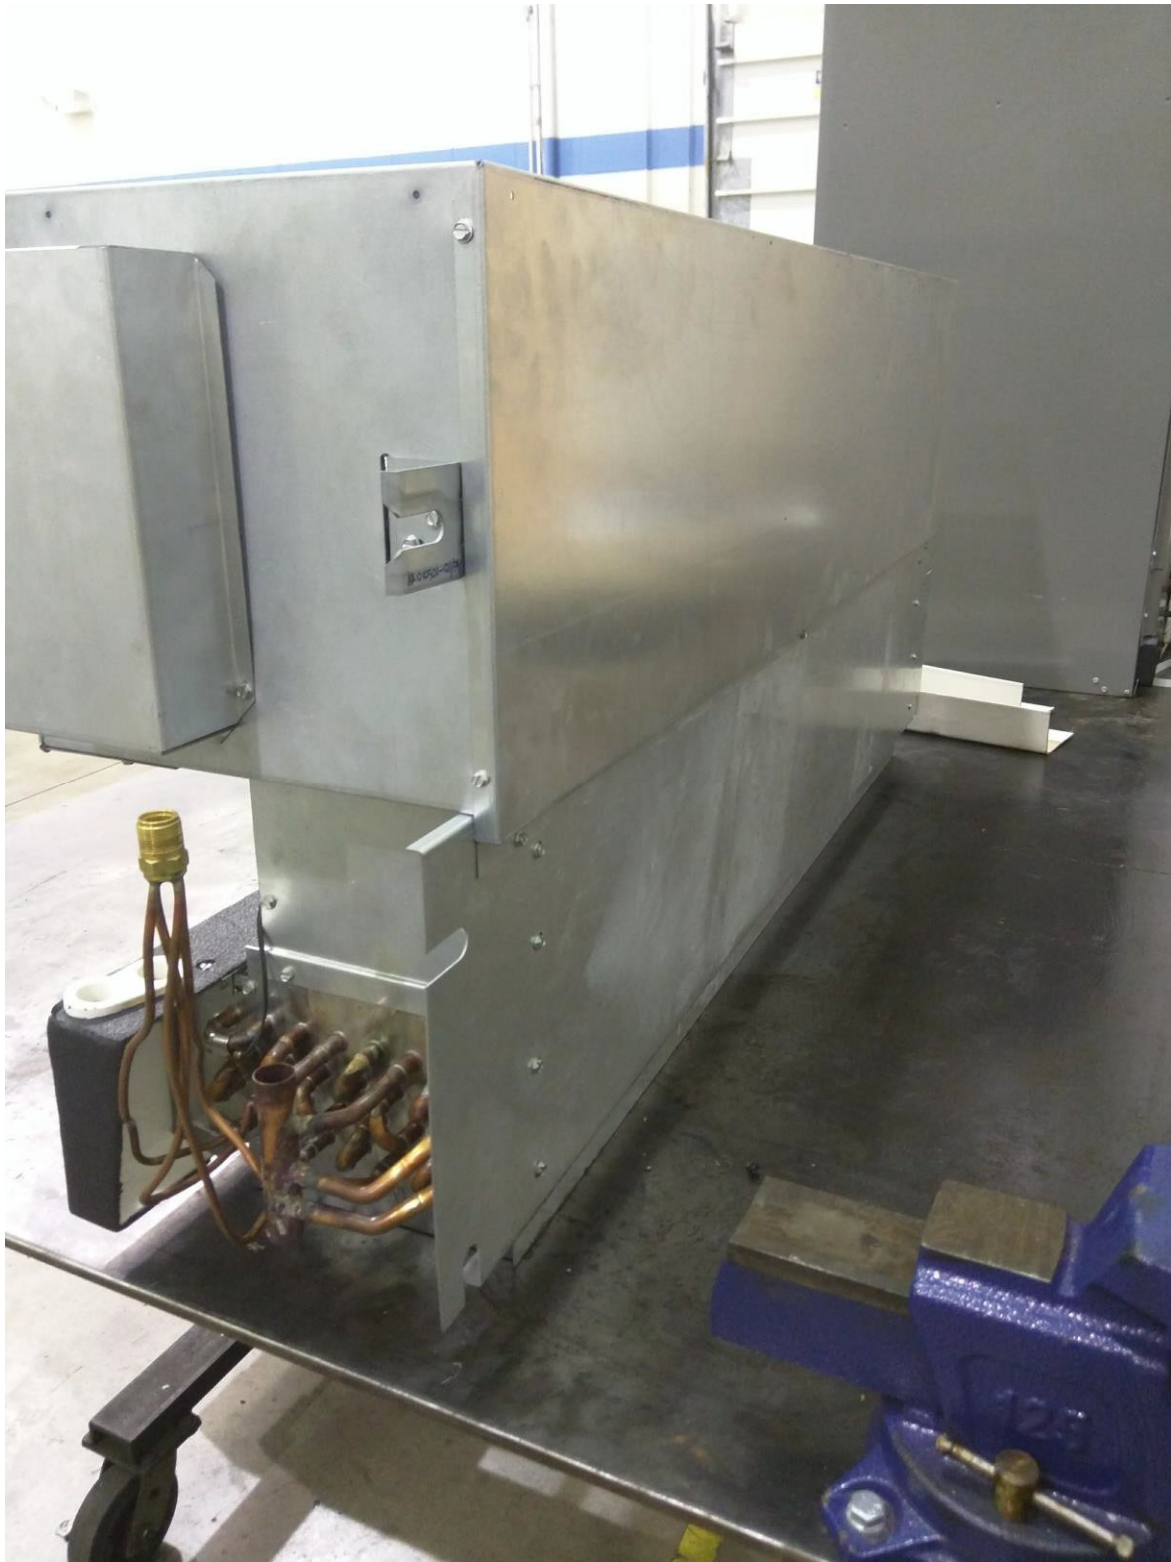


Figures ID 2-3

Indoor unit - exterior 6



Figures ID 2-4

Indoor unit - field wiring compartment

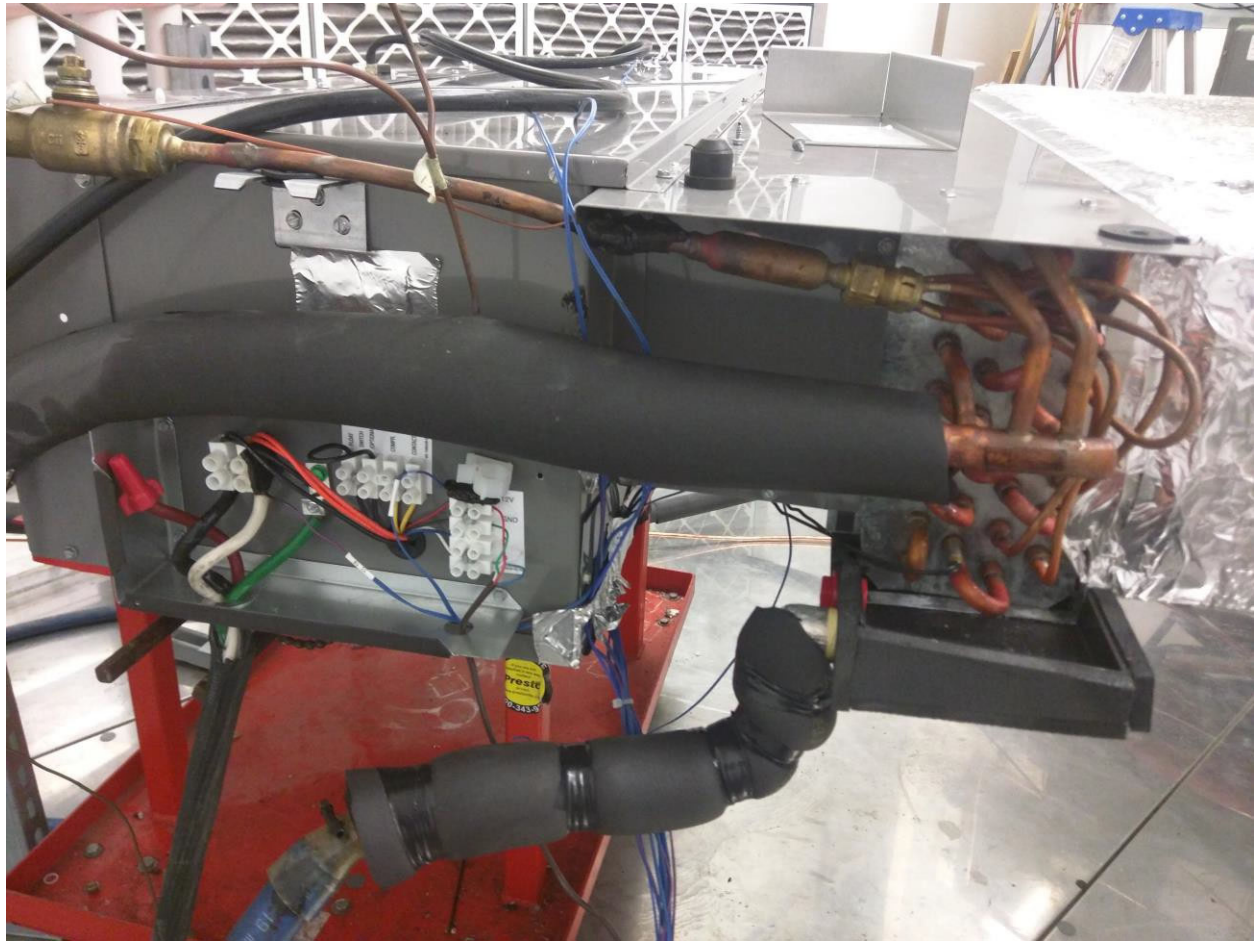


Figures ID 2-5

Indoor unit - field wiring terminals and markings



Figures ID 2-6


Indoor unit - heater kit and electrical compartment

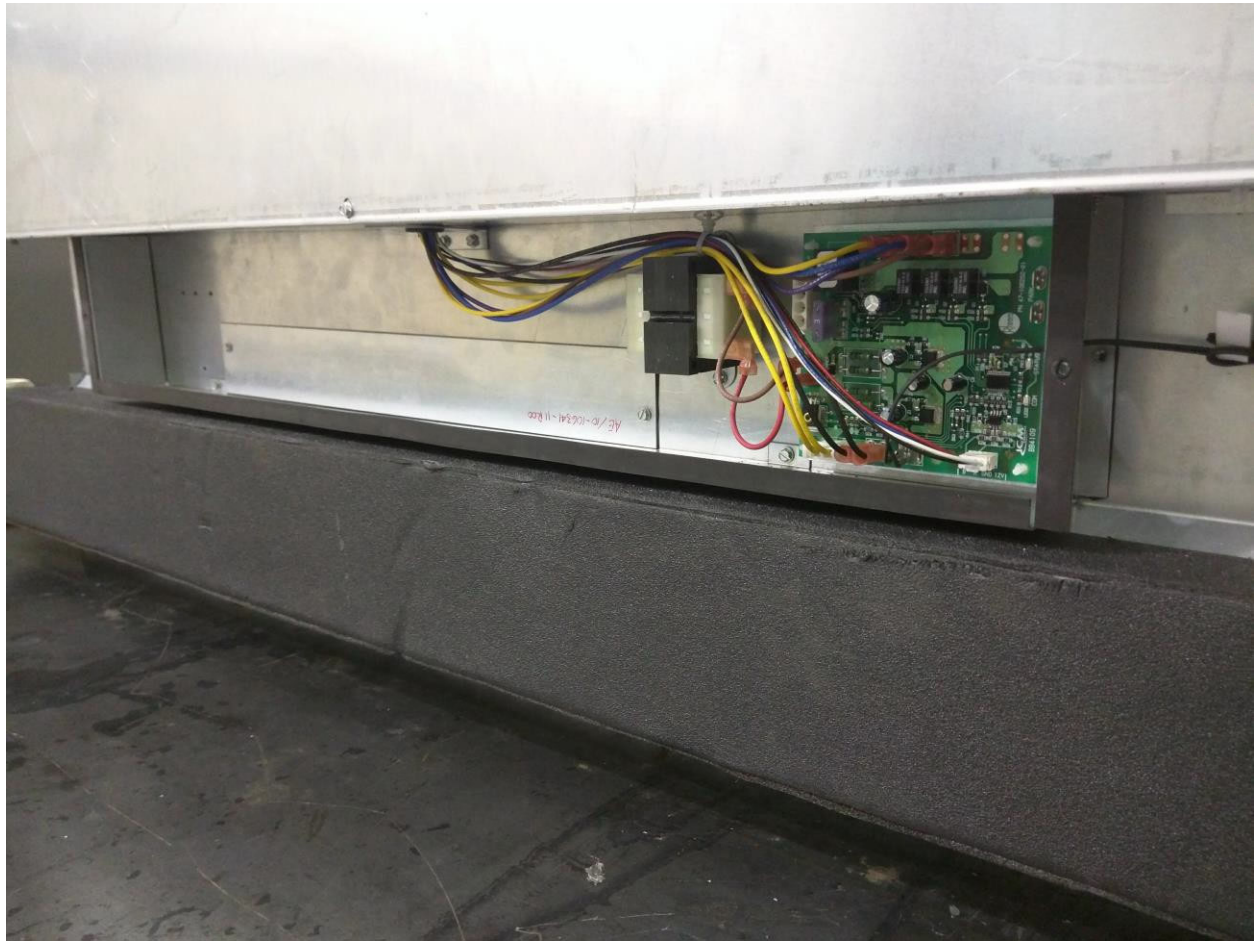



Figures ID 2-7

Indoor unit - motor compartment

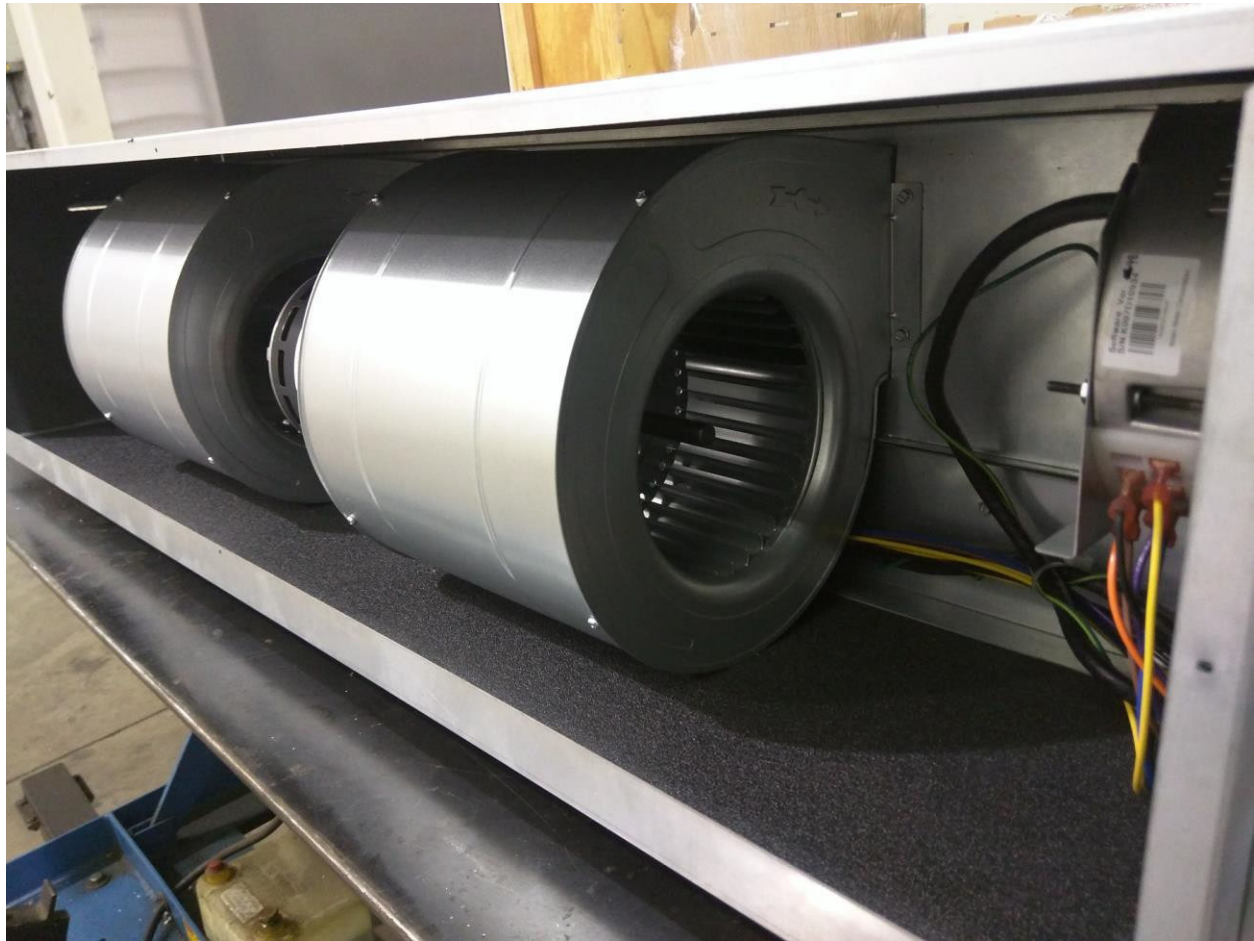


Figures ID 2-8

Indoor unit - motor controller




Figures ID 2-9

Indoor unit - wiring diagram

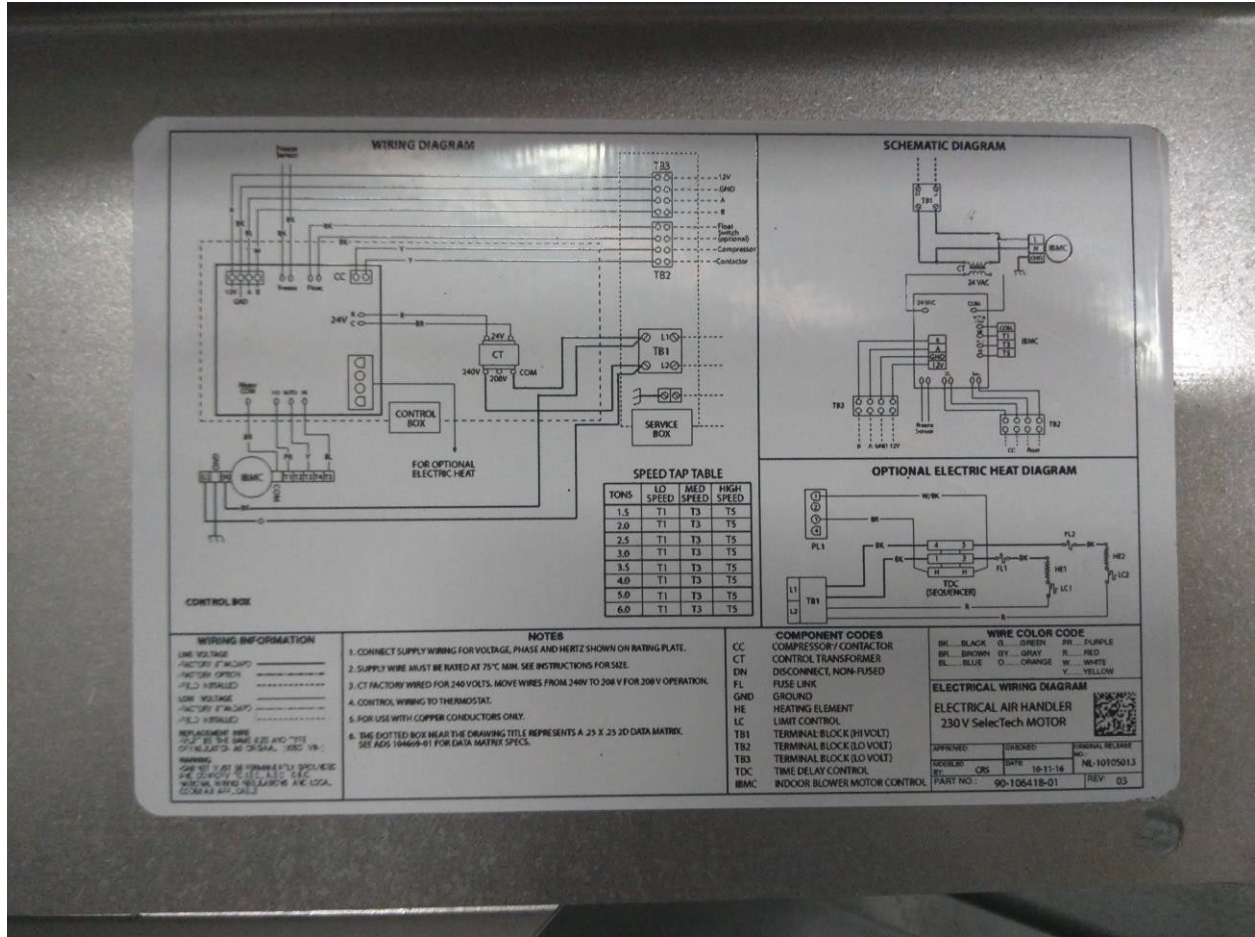

Figures ID 2-10

Indoor unit- heater kit installation site

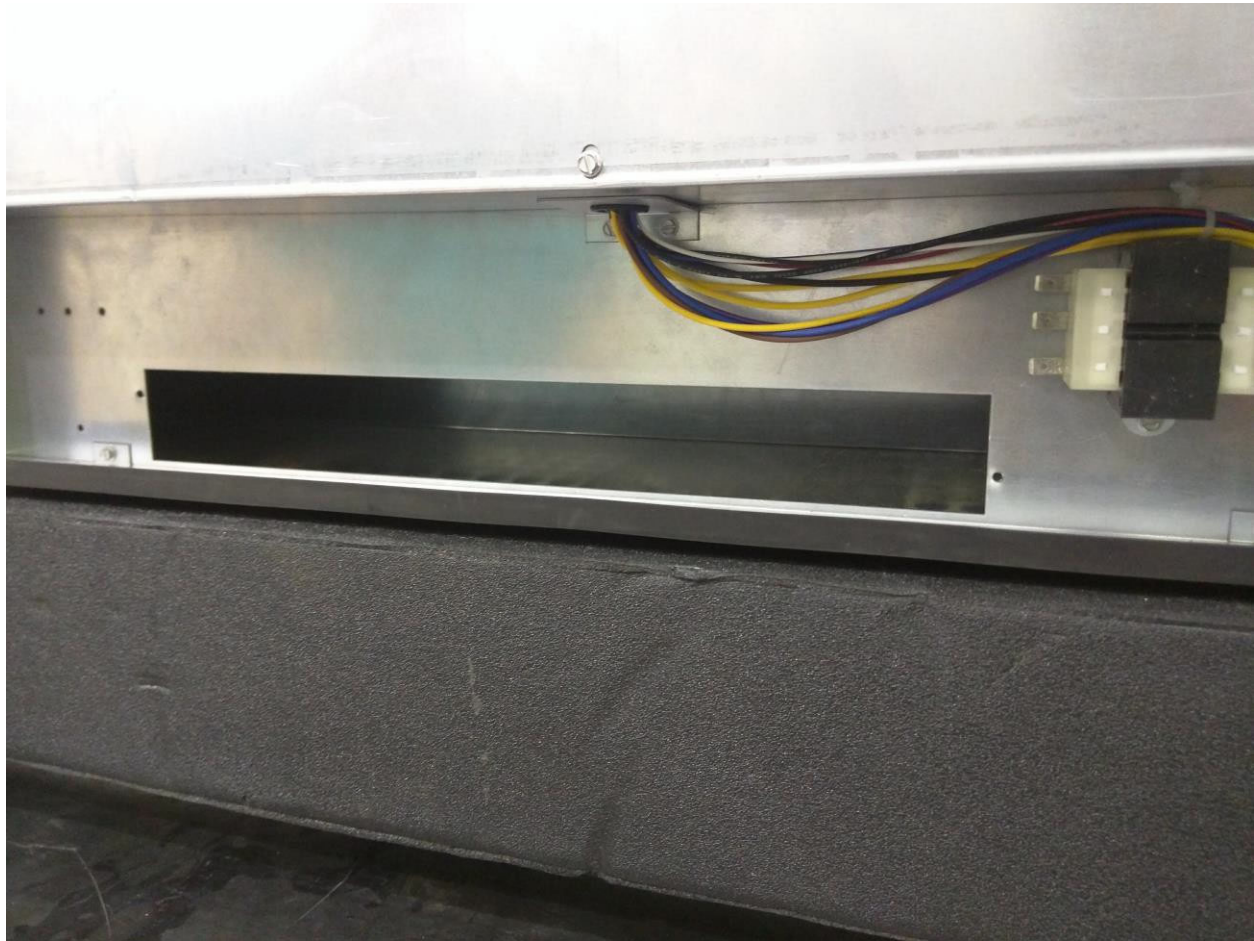


Figures ID 2-11

Outdoor unit - capacitor



Figures ID 2-12

Outdoor unit - contactor

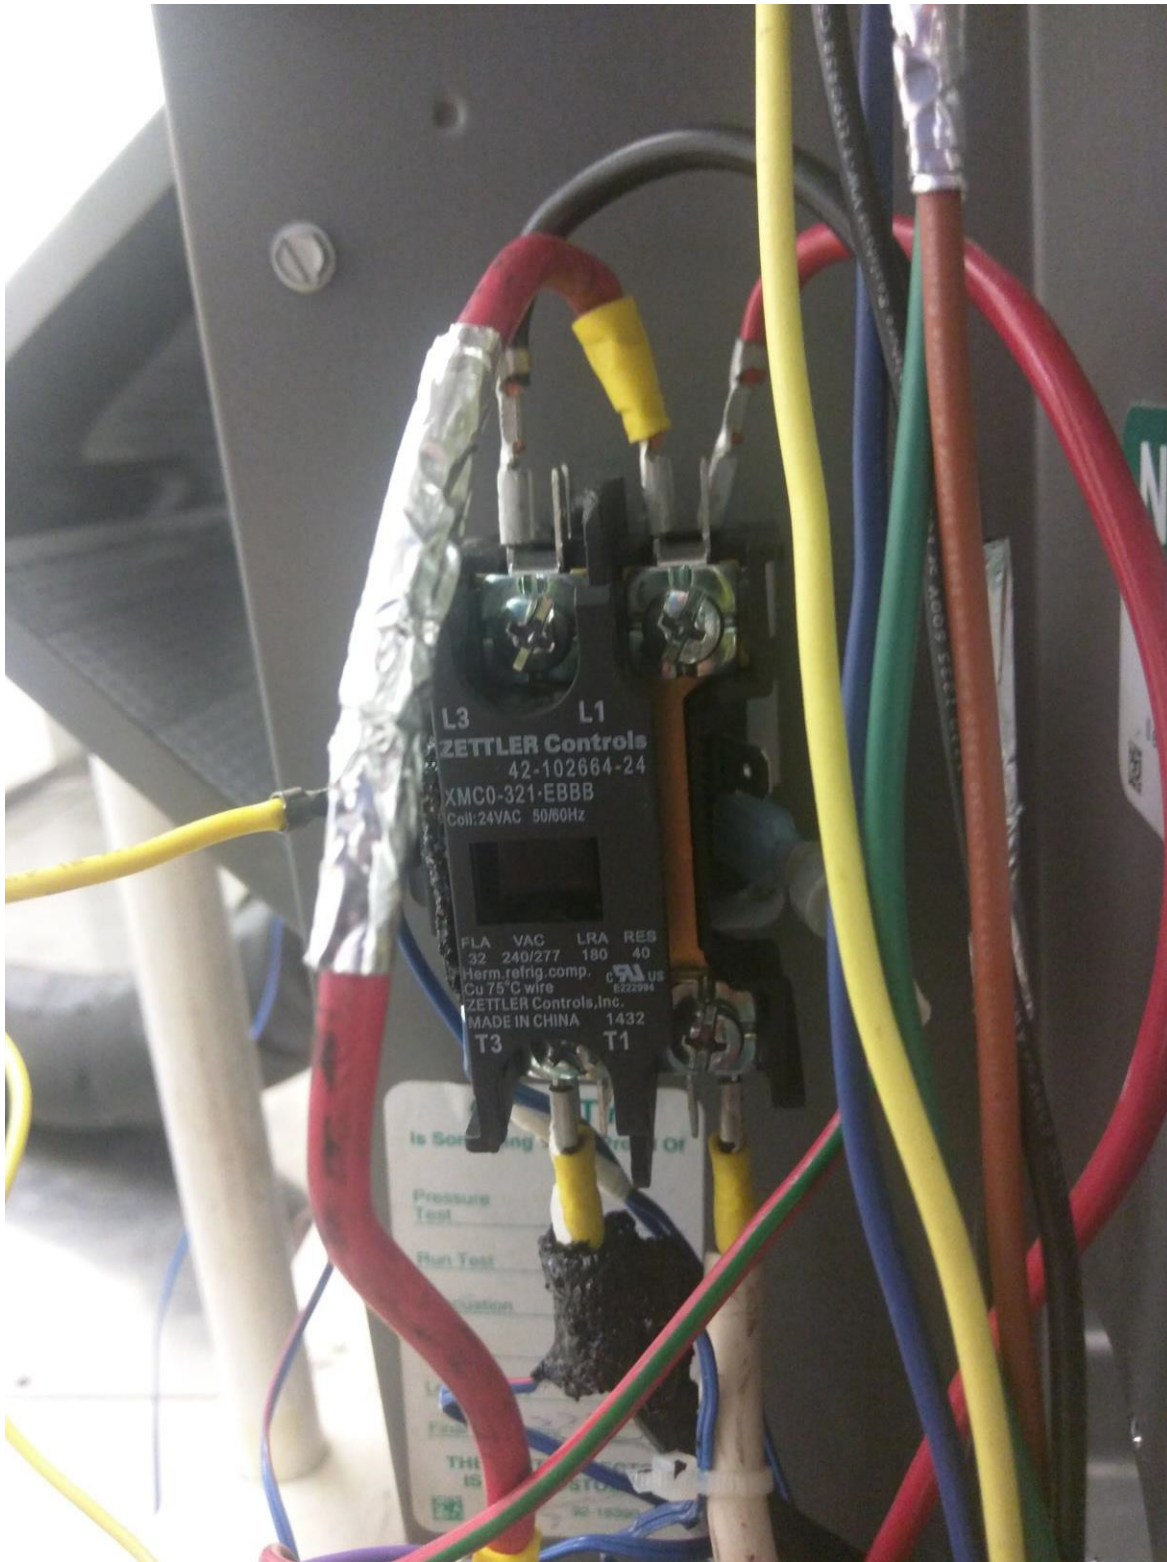

Figures ID 2-13

Outdoor unit - exterior 1



Figures ID 2-14


Outdoor unit - exterior 2





Figures ID 2-15

Outdoor unit - nameplate

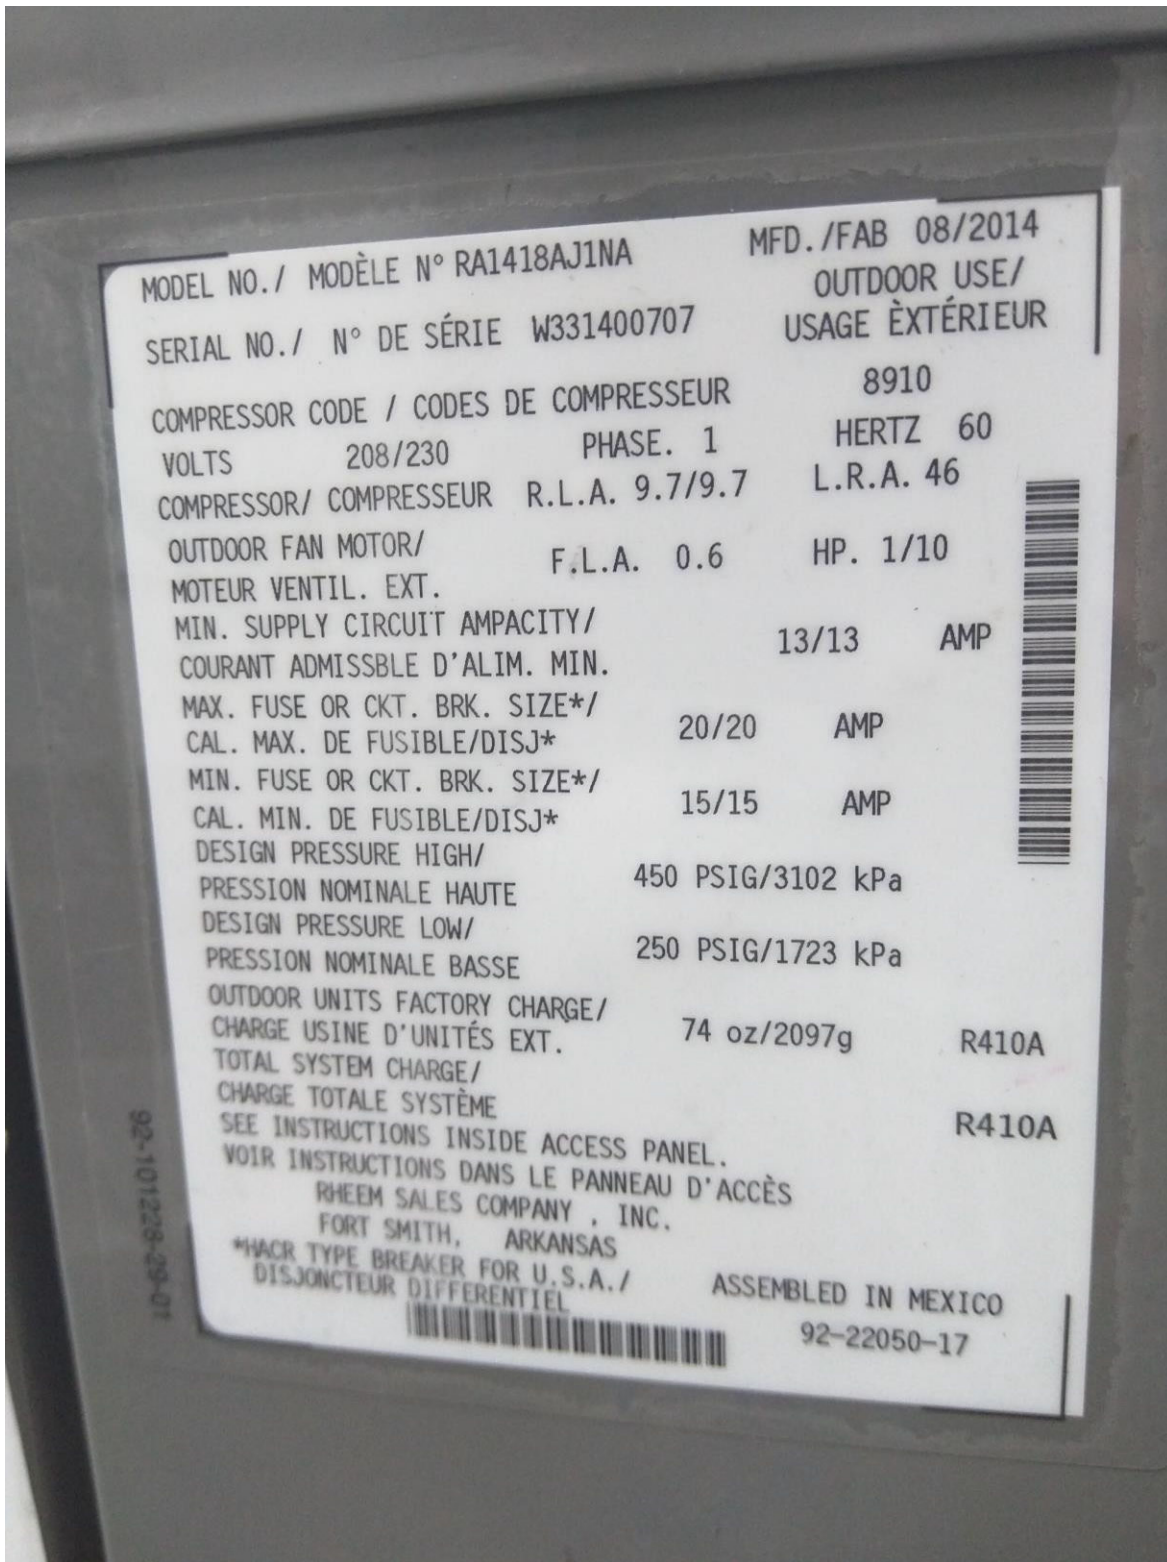


Figures ID 2-16

Indoor Unit - exterior 1



Figures ID 2-17

Indoor Unit - exterior 2

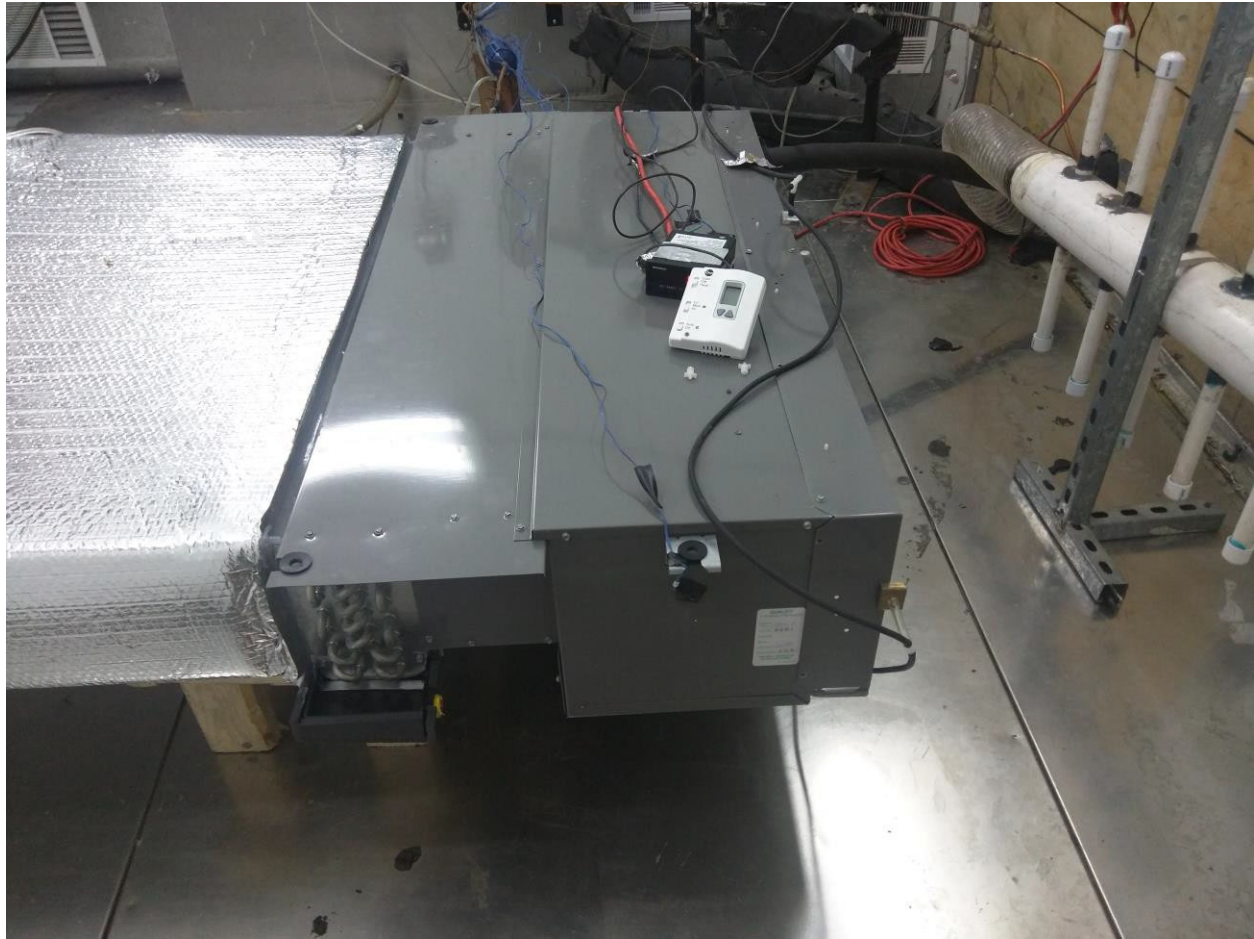


Figures ID 2-18

Indoor unit - exterior 3




Figures ID 2-A4-1

Air Handler nameplate

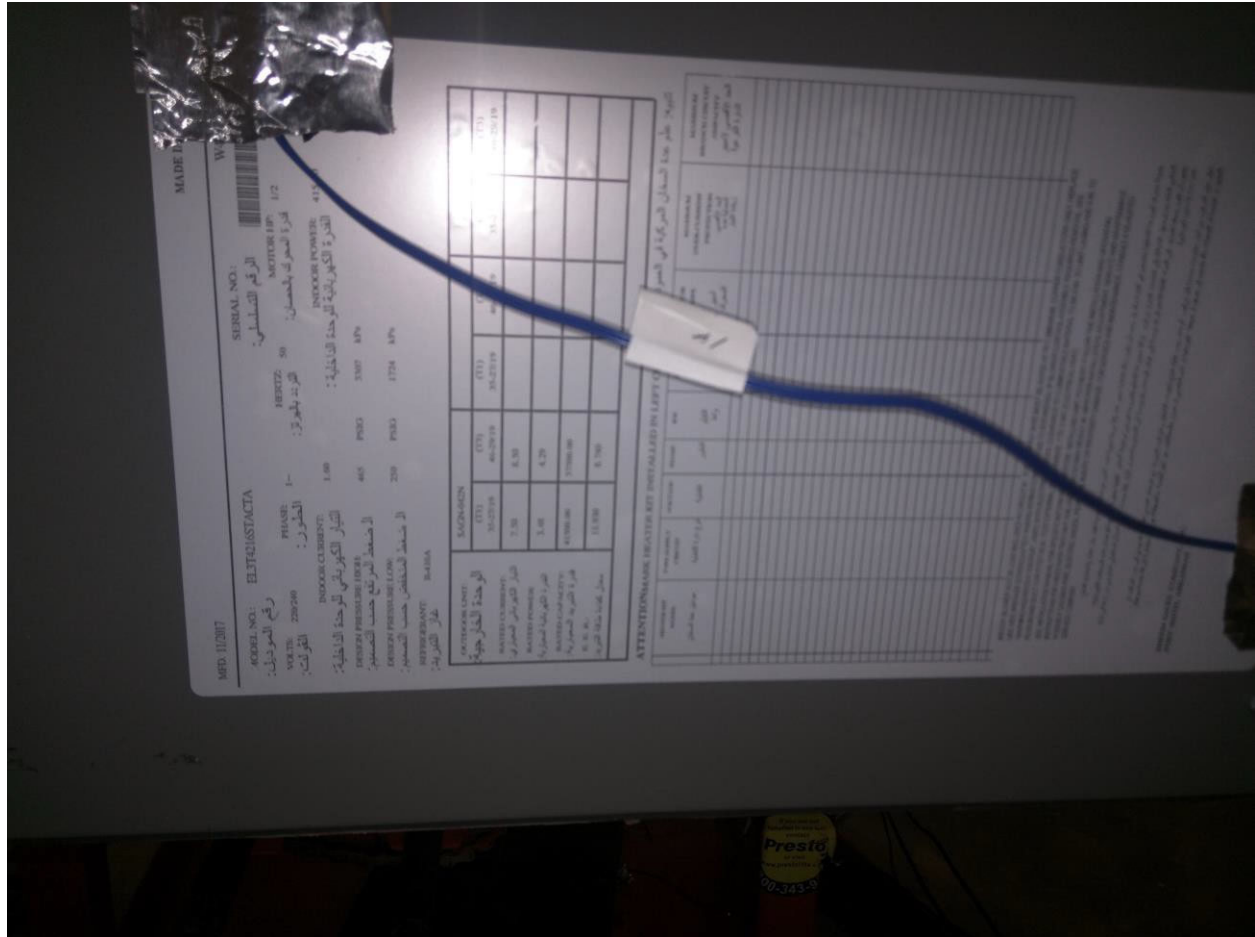


Figures ID 2-A4-2

Condensing Unit nameplate

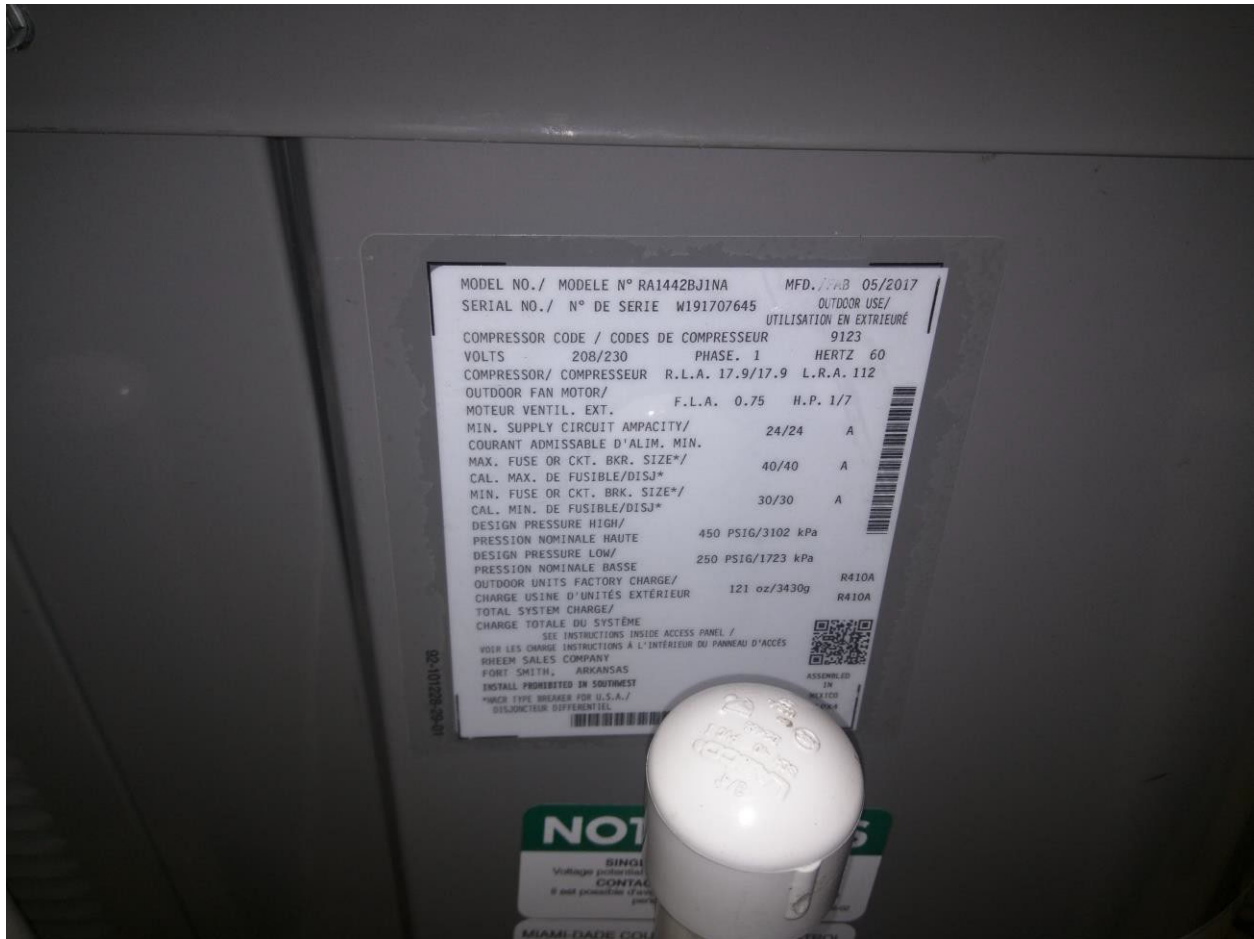


Figures ID 2-A4-3

Control compartment

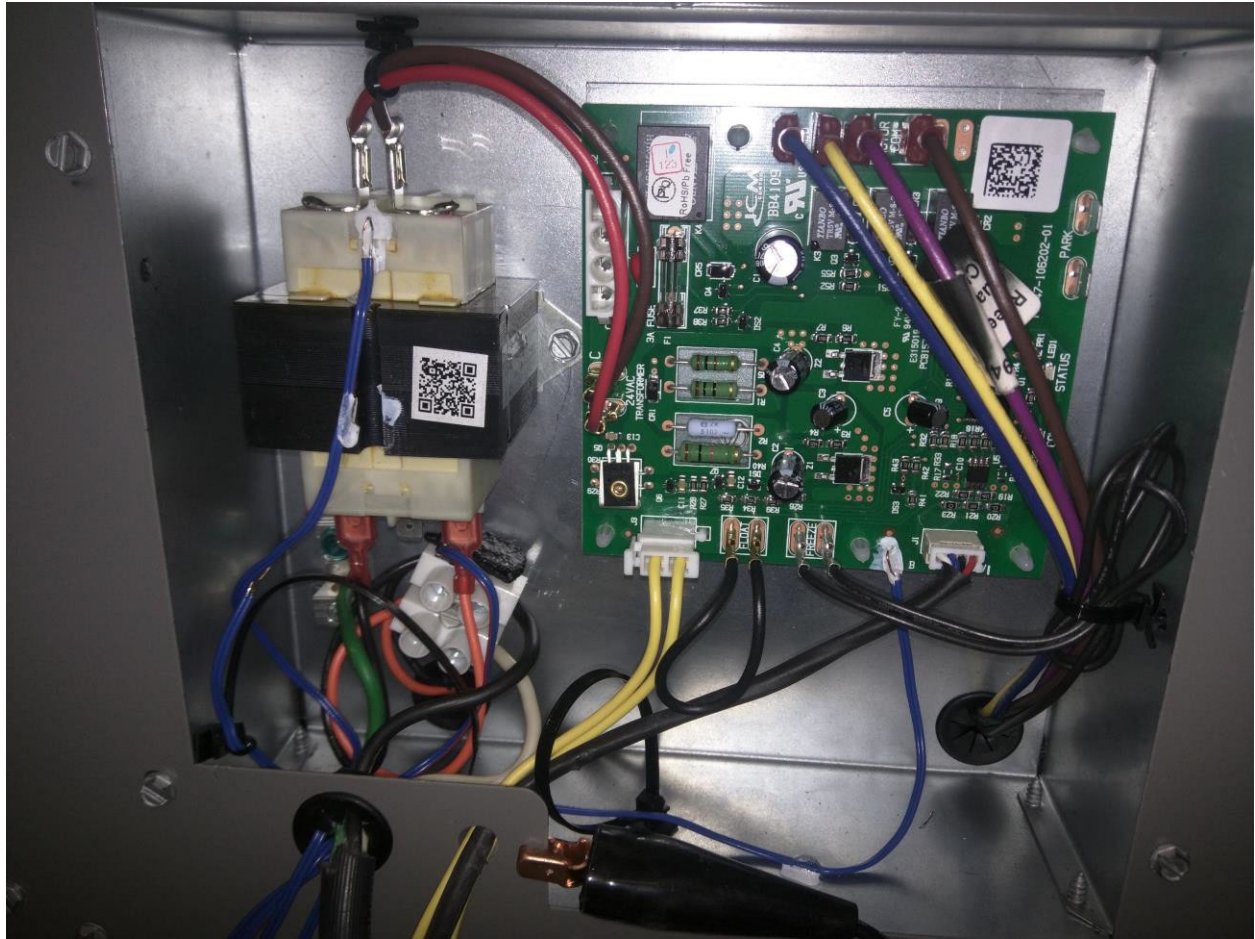

Figures ID 2-A4-4

Transformer

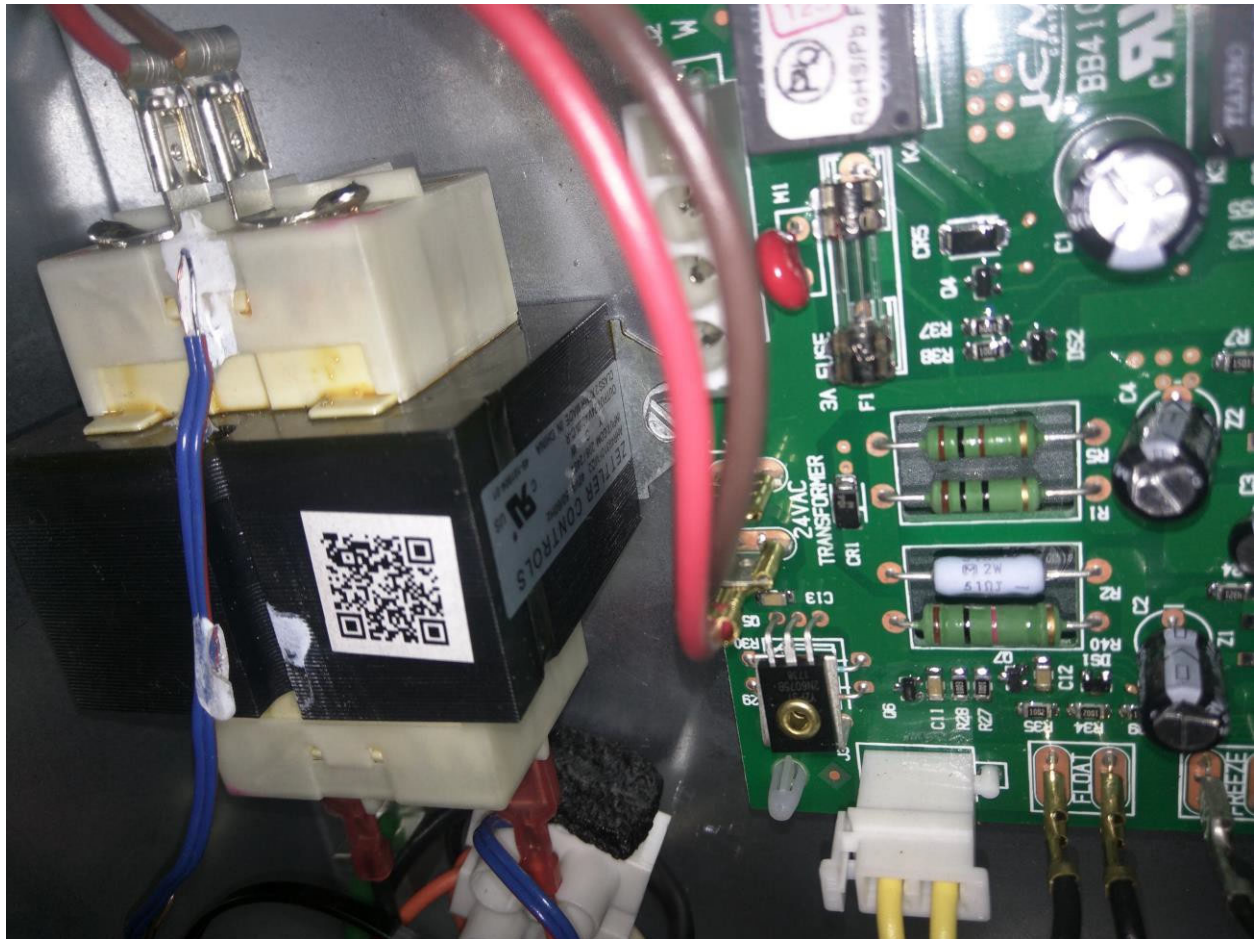




Figures ID 2-A4-5

3.5 ton air handler



Figures ID 2:A5-1

Indoor unit - field wiring compartment

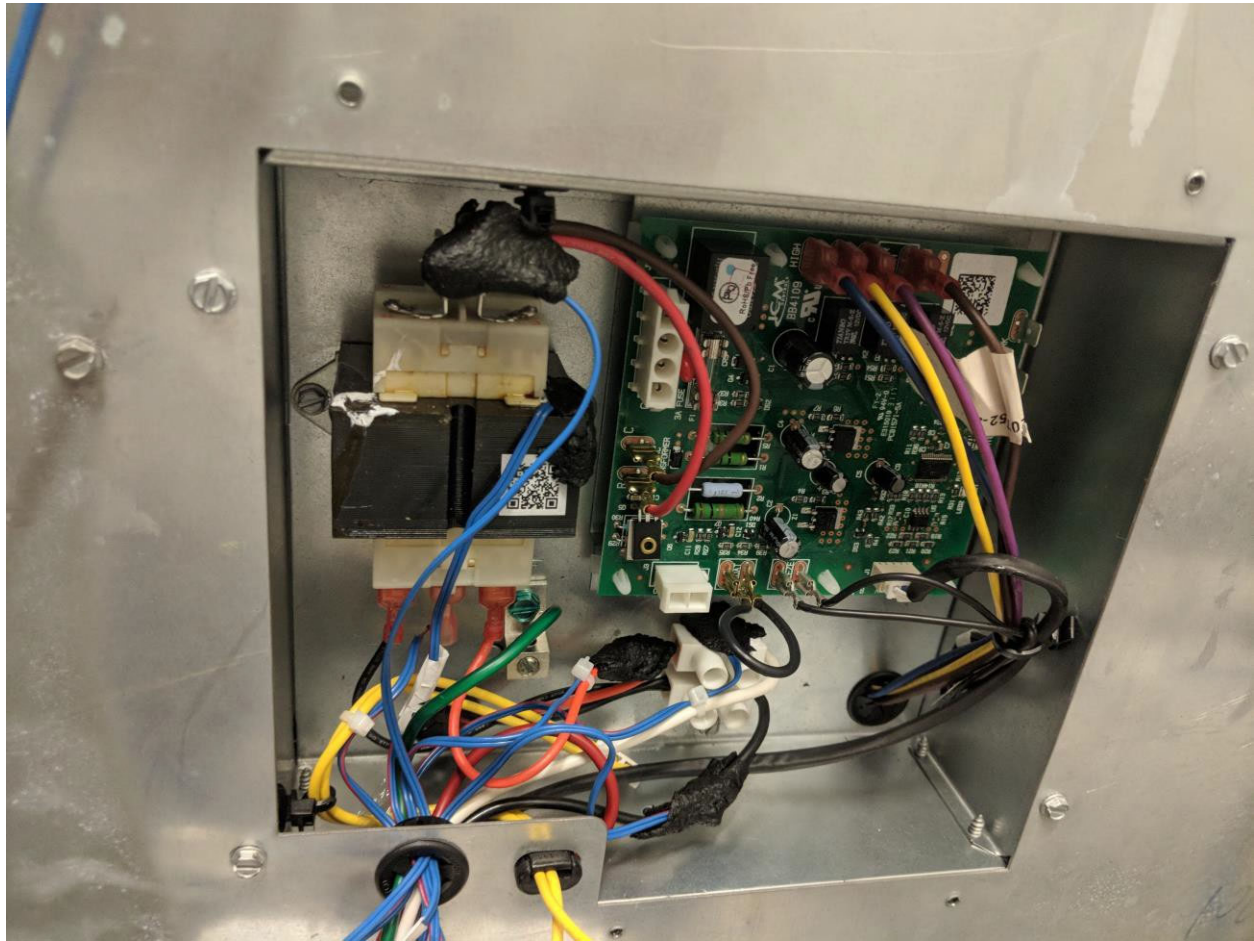


Figures ID 2:A5-2

Indoor unit - motor compartment




Figures ID 2:A5-3

Indoor unit - wiring diagram

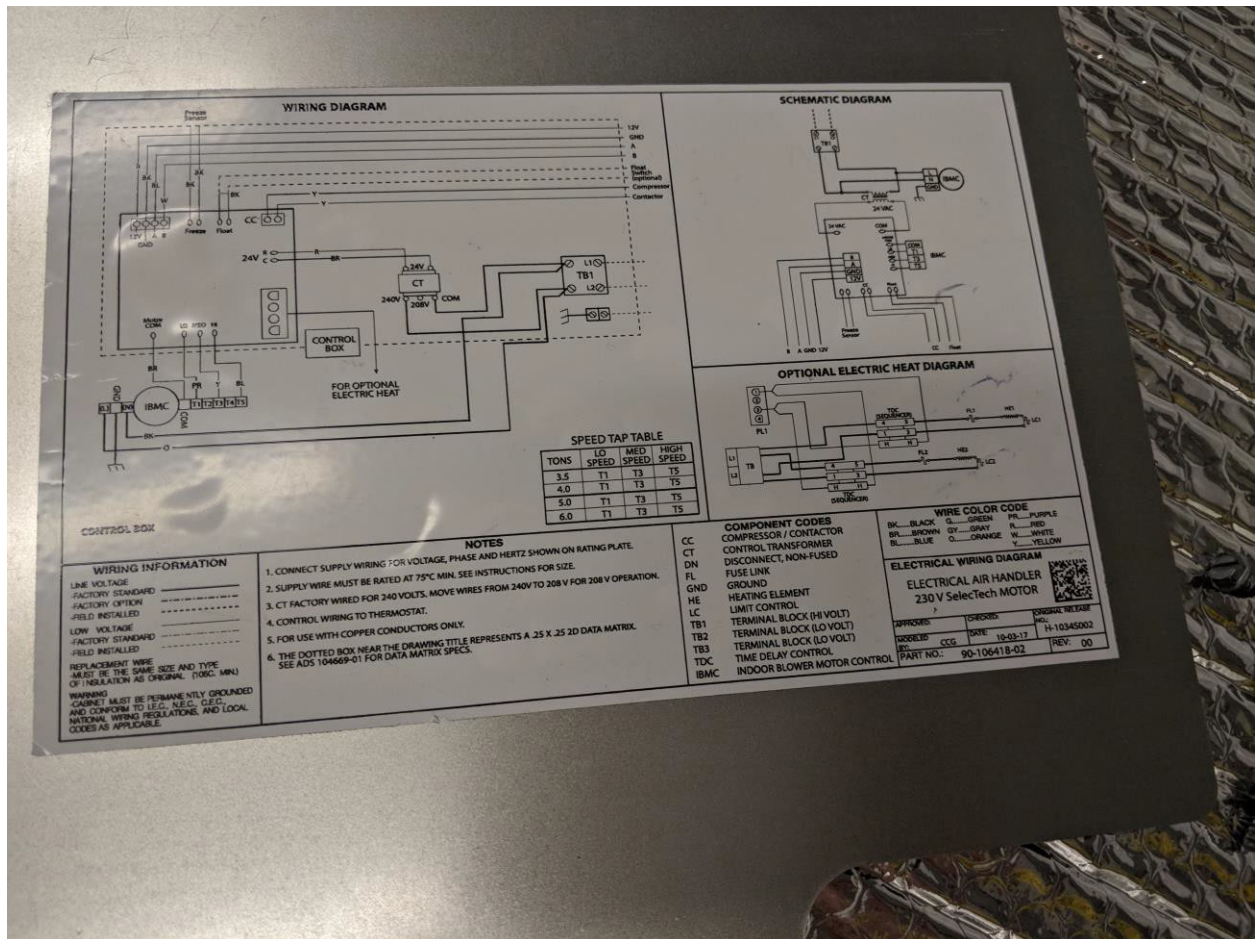


Figures ID 2:A5-4

Outdoor unit - exterior back

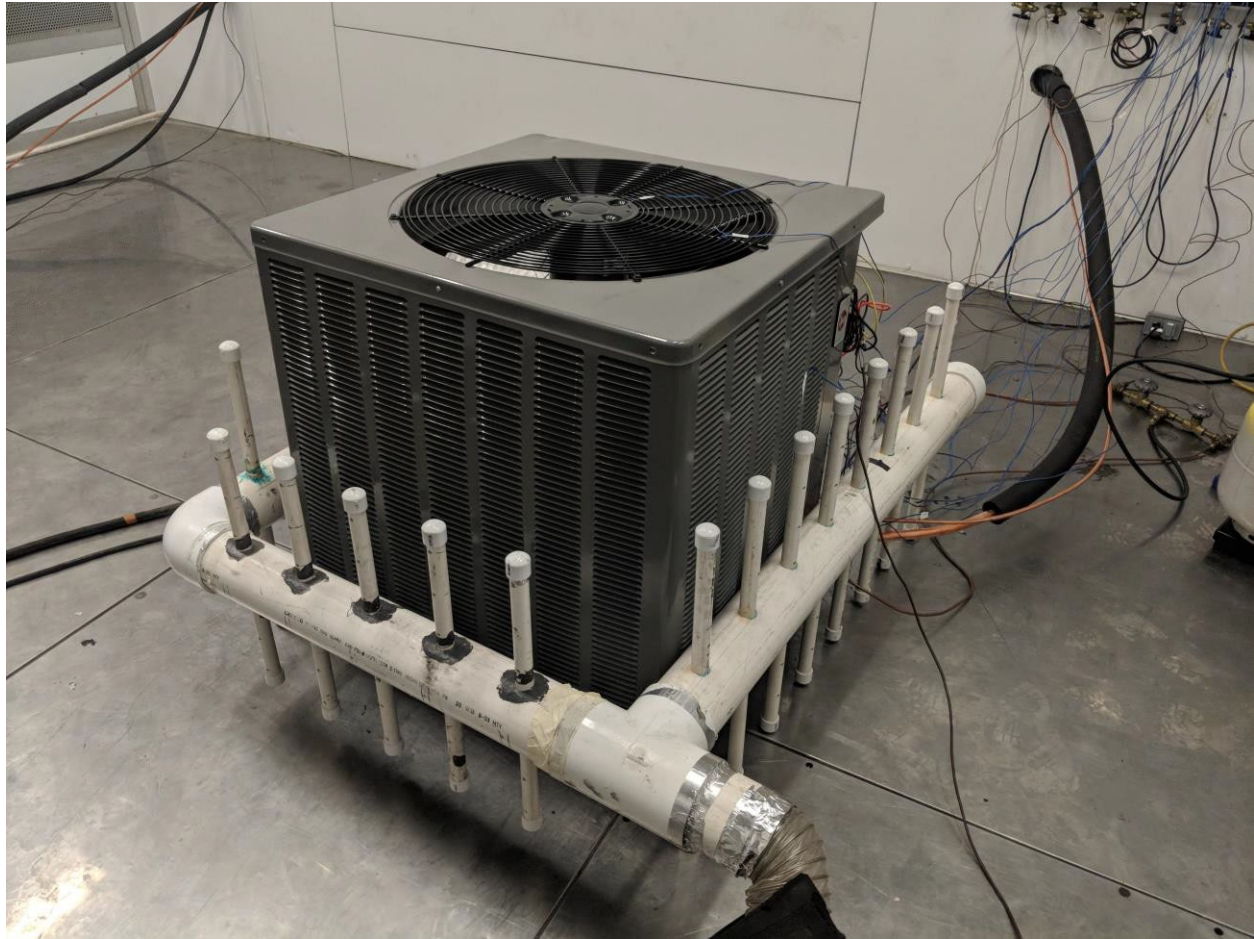


Figures ID 2:A5-5

Outdoor unit - exterior front

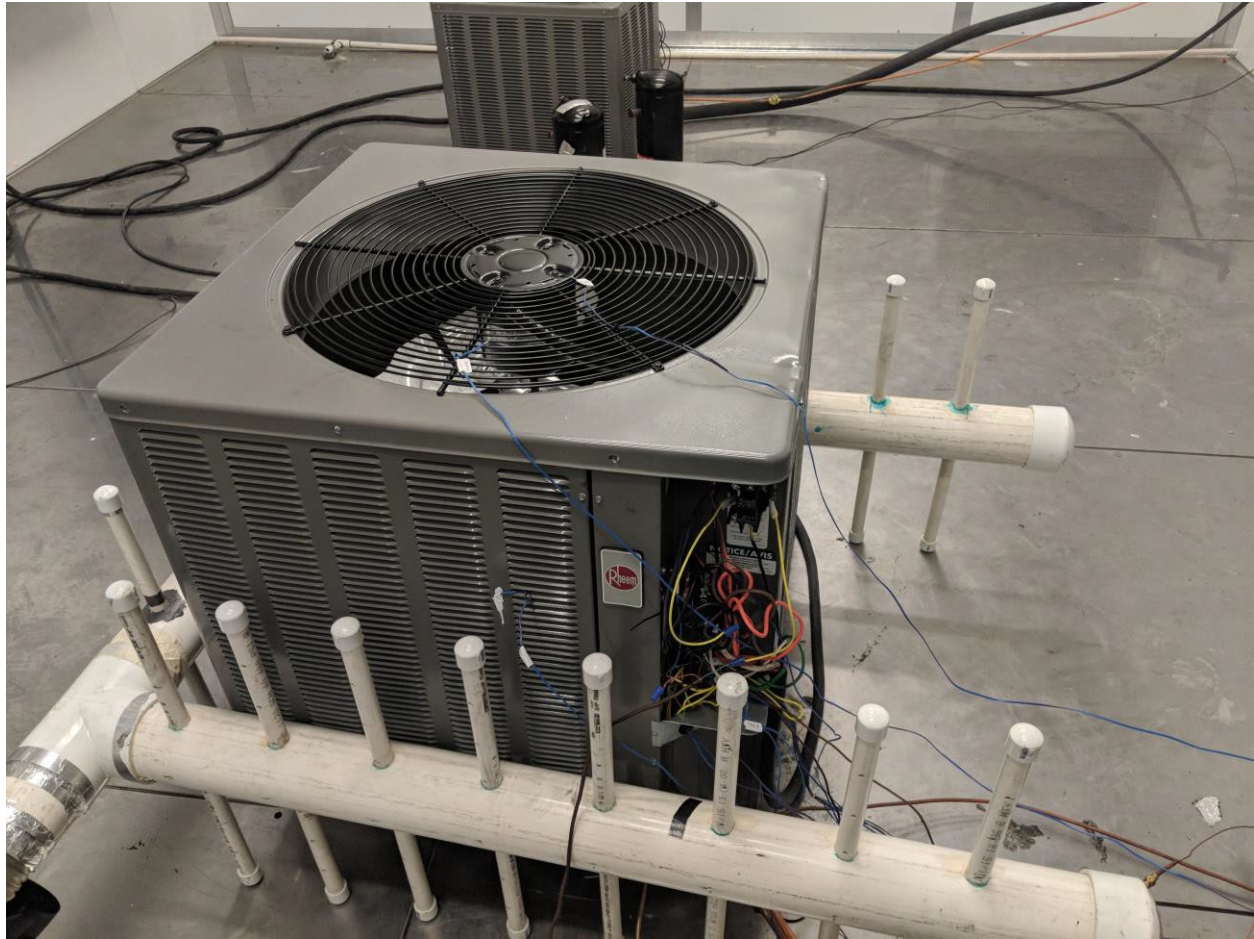


Figures ID 2:A5-6

Outdoor unit - field wiring compartment

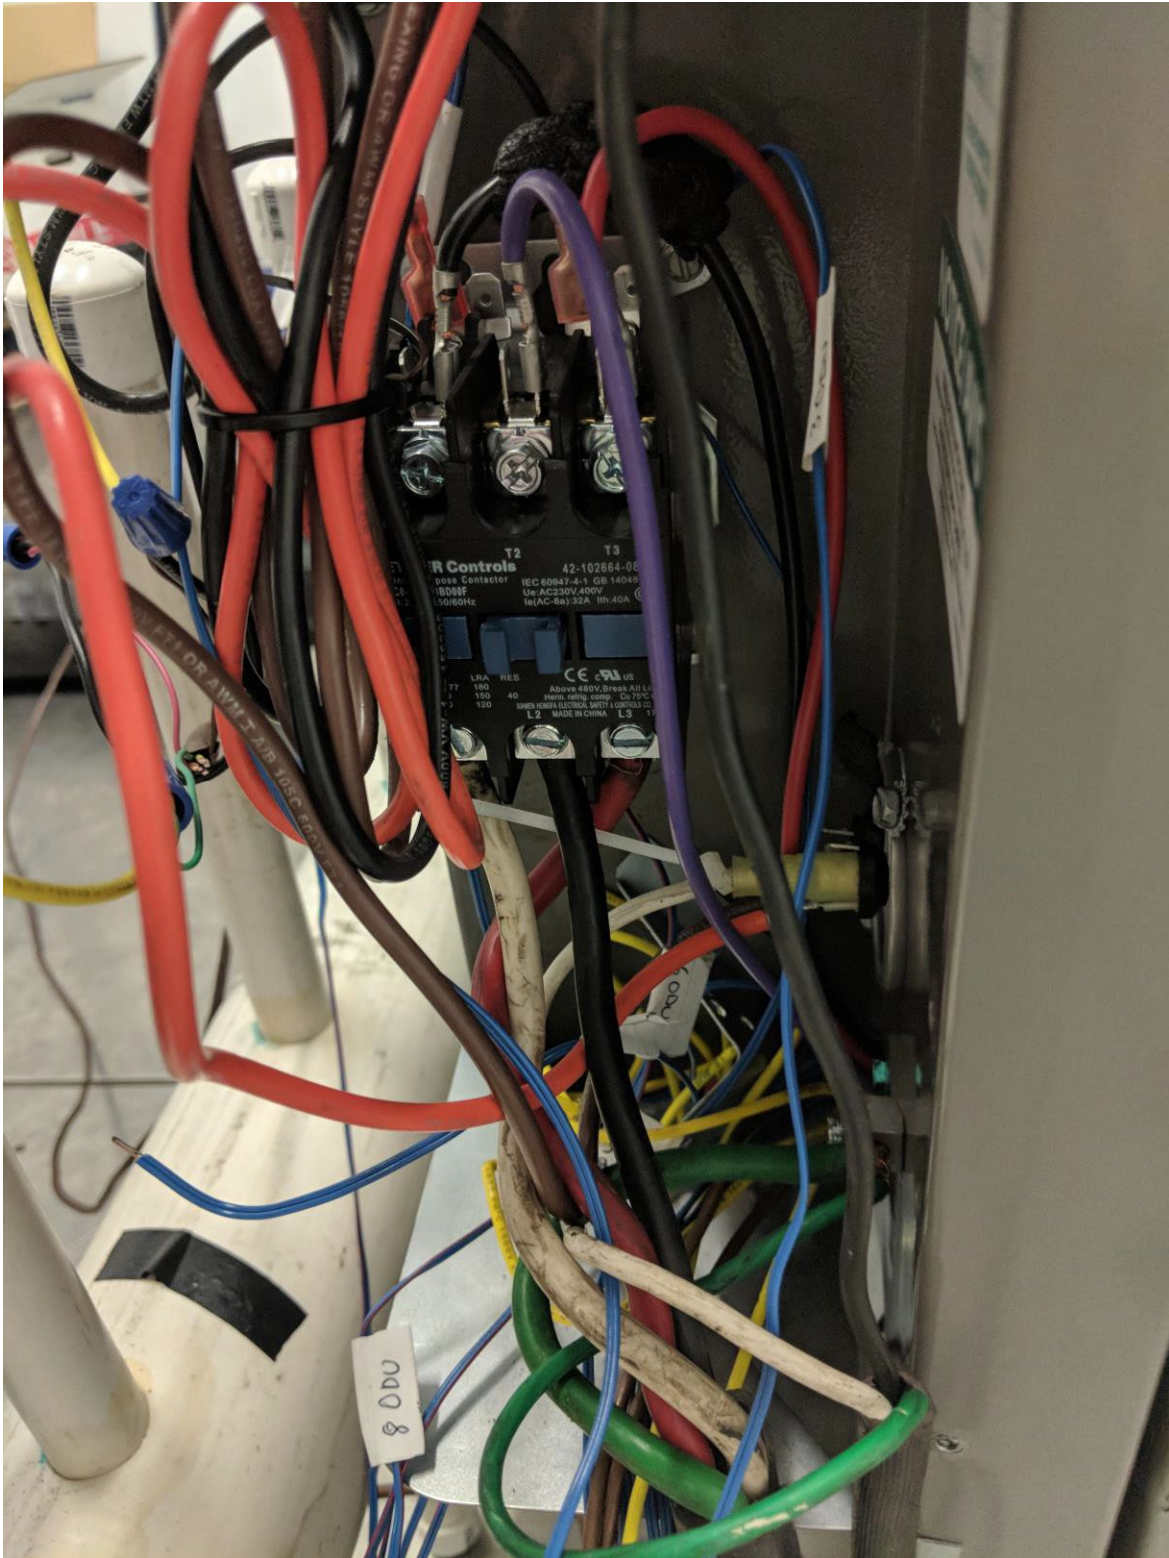

Figures ID 2:A5-7

Indoor unit - exterior on wiring compartment side

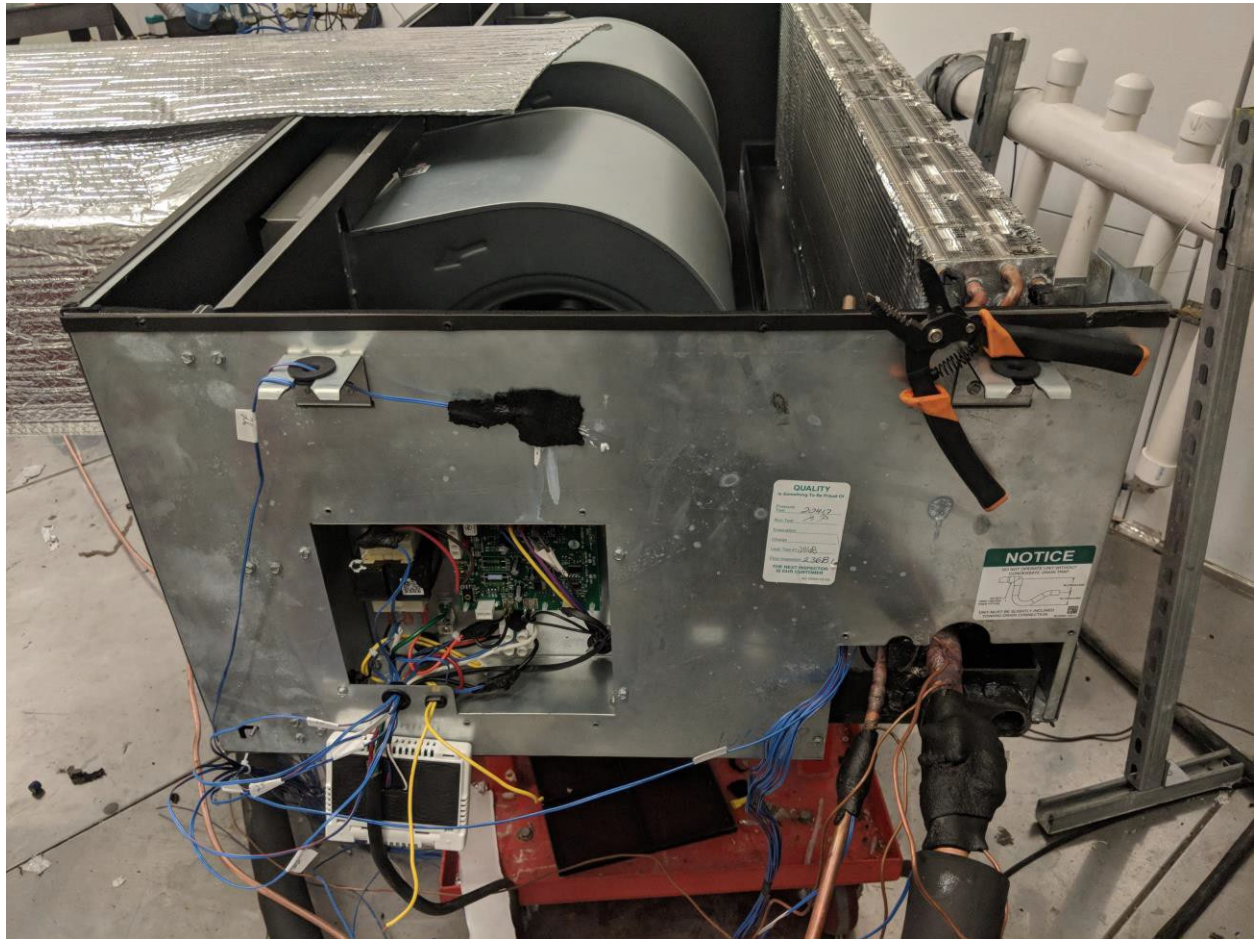



Figures ID 2:A5-8

Indoor unit - exterior test duct



Figures ID 2:A5-9

Indoor unit - Field wiring compartment cover

